ITEM NO	QUANTITY/UM	PART NO	DESCRIPTION
1	4.00 EA	1004902951	BRKT,SEISMIC_ANCHOR,3/8"X3"X3"X3"LG
2	10.00 EA	1004902952	SCR,SLFTPG,HEX_HD,TEK,1/4"-14X1-1/4"

ATTACH EACH BRACKET TO BOILER USING 1/4"-14 x 1 1/4" TEK SCREWS
PROVIDED WITH THIS KIT. (2) SCREWS PER BRACKET, (8) SCREWS PER UNIT

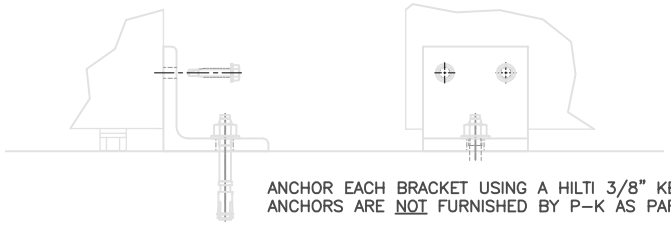

ANCHOR EACH BRACKET USING A HILTI 3/8" KB-TZ ANCHOR MIN. EMBED. = 2"
ANCHORS ARE NOT FURNISHED BY P-K AS PART OF THIS KIT

WHERE KB-TZ ANCHOR CAN'T BE USED DUE TO SLAB THICKNESS LIMITS,
USE (4) 3/8"ø A307 BOLTS THRU FLOOR TO STRUT BELOW. (BY ENGINEER OF RECORD)

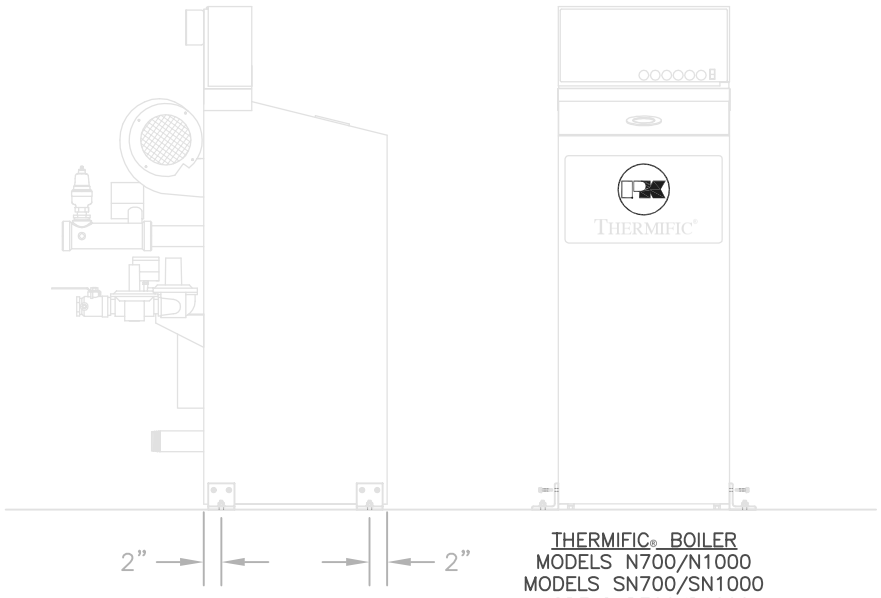

THERMIFIC® BOILER
MODELS N700/N1000
MODELS SN700/SN1000
MODELS D700/D1000
MODELS SD700/SD1000

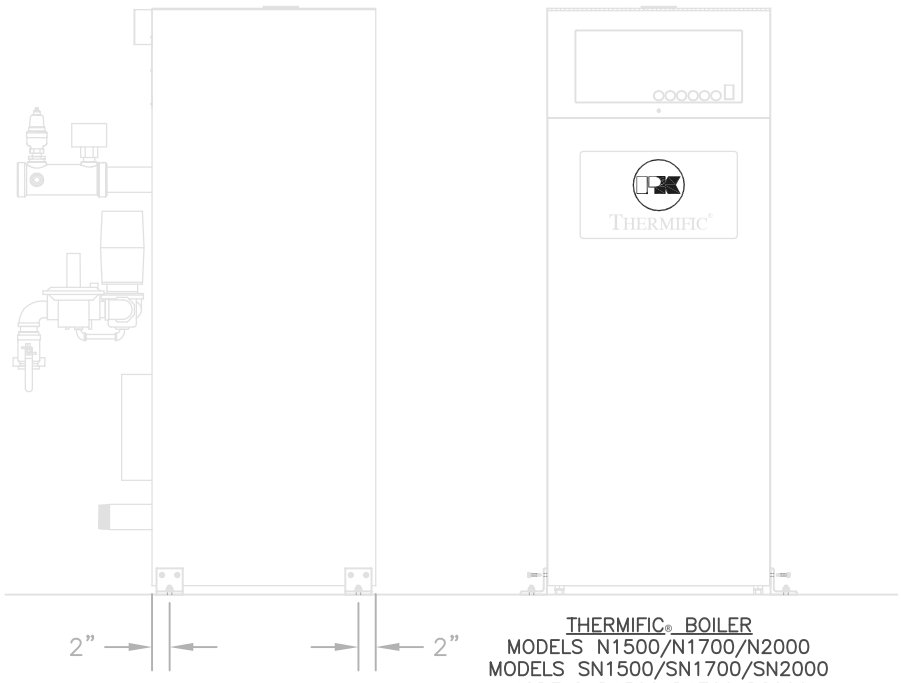

THERMIFIC® BOILER
MODELS N1500/N1700/N2000
MODELS SN1500/SN1700/SN2000
MODELS D1500/D1700/D2000
MODELS SD1500/SD1700/SD2000

REV.	DESCRIPTION	BY	CK'D.	DATE

ASME CODE YES	ASME CODE NO	DESIGN PRESS.	TYPE X-RAY NONE	TYPE X-RAY SPOT	TYPE X-RAY FULL	APPROX. WEIGHT LBS.
	X	N/C	X			N/A

TITLE: KIT,SEISMIC_ANCHOR,THERMIFIC (SIDE 1)

THIS DRAWING, INFORMATION AND THE SUBJECT MATTER THEREOF, ARE THE SOLE AND EXCLUSIVE PROPERTY OF PATTERSON-KELLEY CO, HARSCO CORPORATION, EAST STROUDSBURG, PA. IT MAY BE REPRODUCED BY THE PURCHASER OF THIS EQUIPMENT FOR THEIR INTERNAL USE ONLY. IT CANNOT BE DISTRIBUTED TO ANY OTHER FIRM OR PARTY WITHOUT WRITTEN CONSENT FROM OUR COMPANY.

Patterson-Kelley
Harsco
East Stroudsburg, PA 18301
570-421-7500

	BY	DATE
DRAWN	JS	09-22-08
CHECKED		
APPROVED		

FILE SIZE: D
REFERENCE NO.:
PRINT NO.: BP00000252
REV.: