





6.2 Wiring Diagrams

6.2.1 SL-1500 & SL-2000 Natural Gas



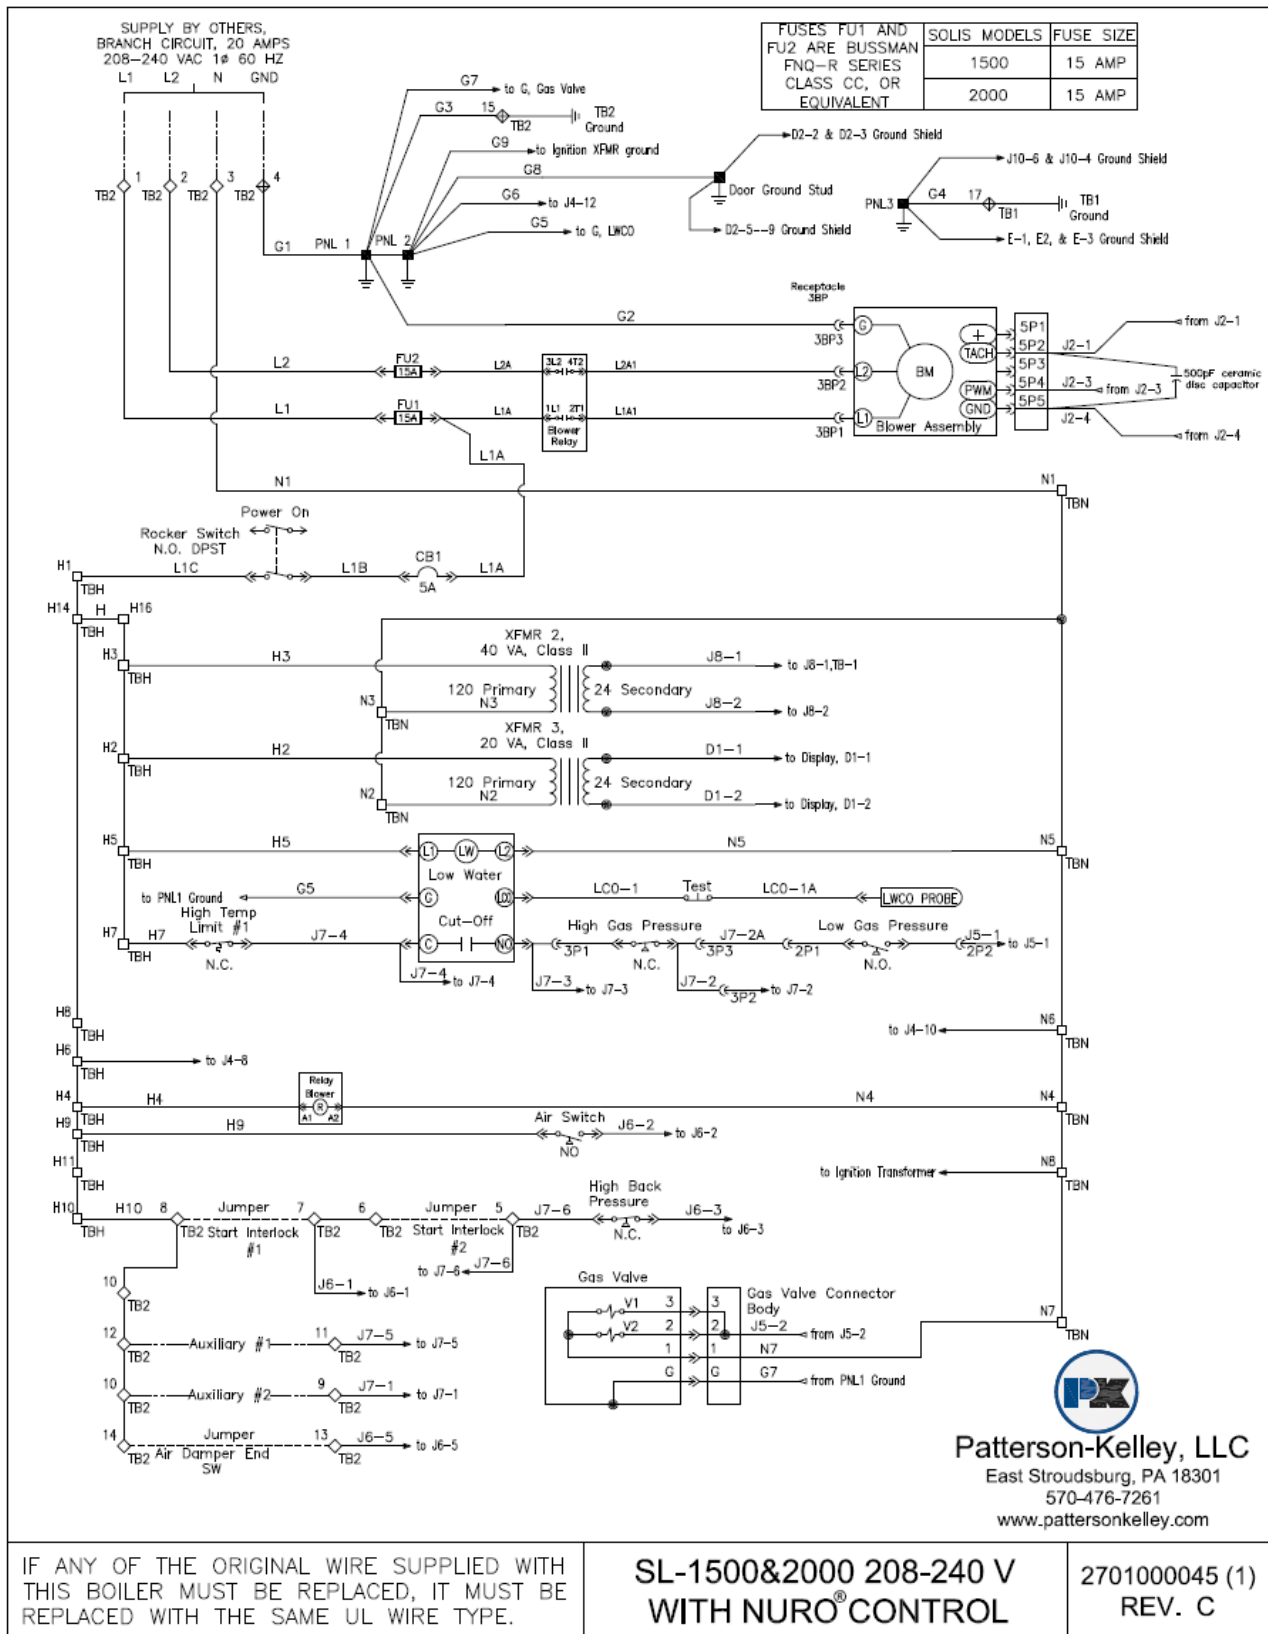

P-K SOLIS™ Gas Fired Boiler
Technical Service 1.877.728.5351

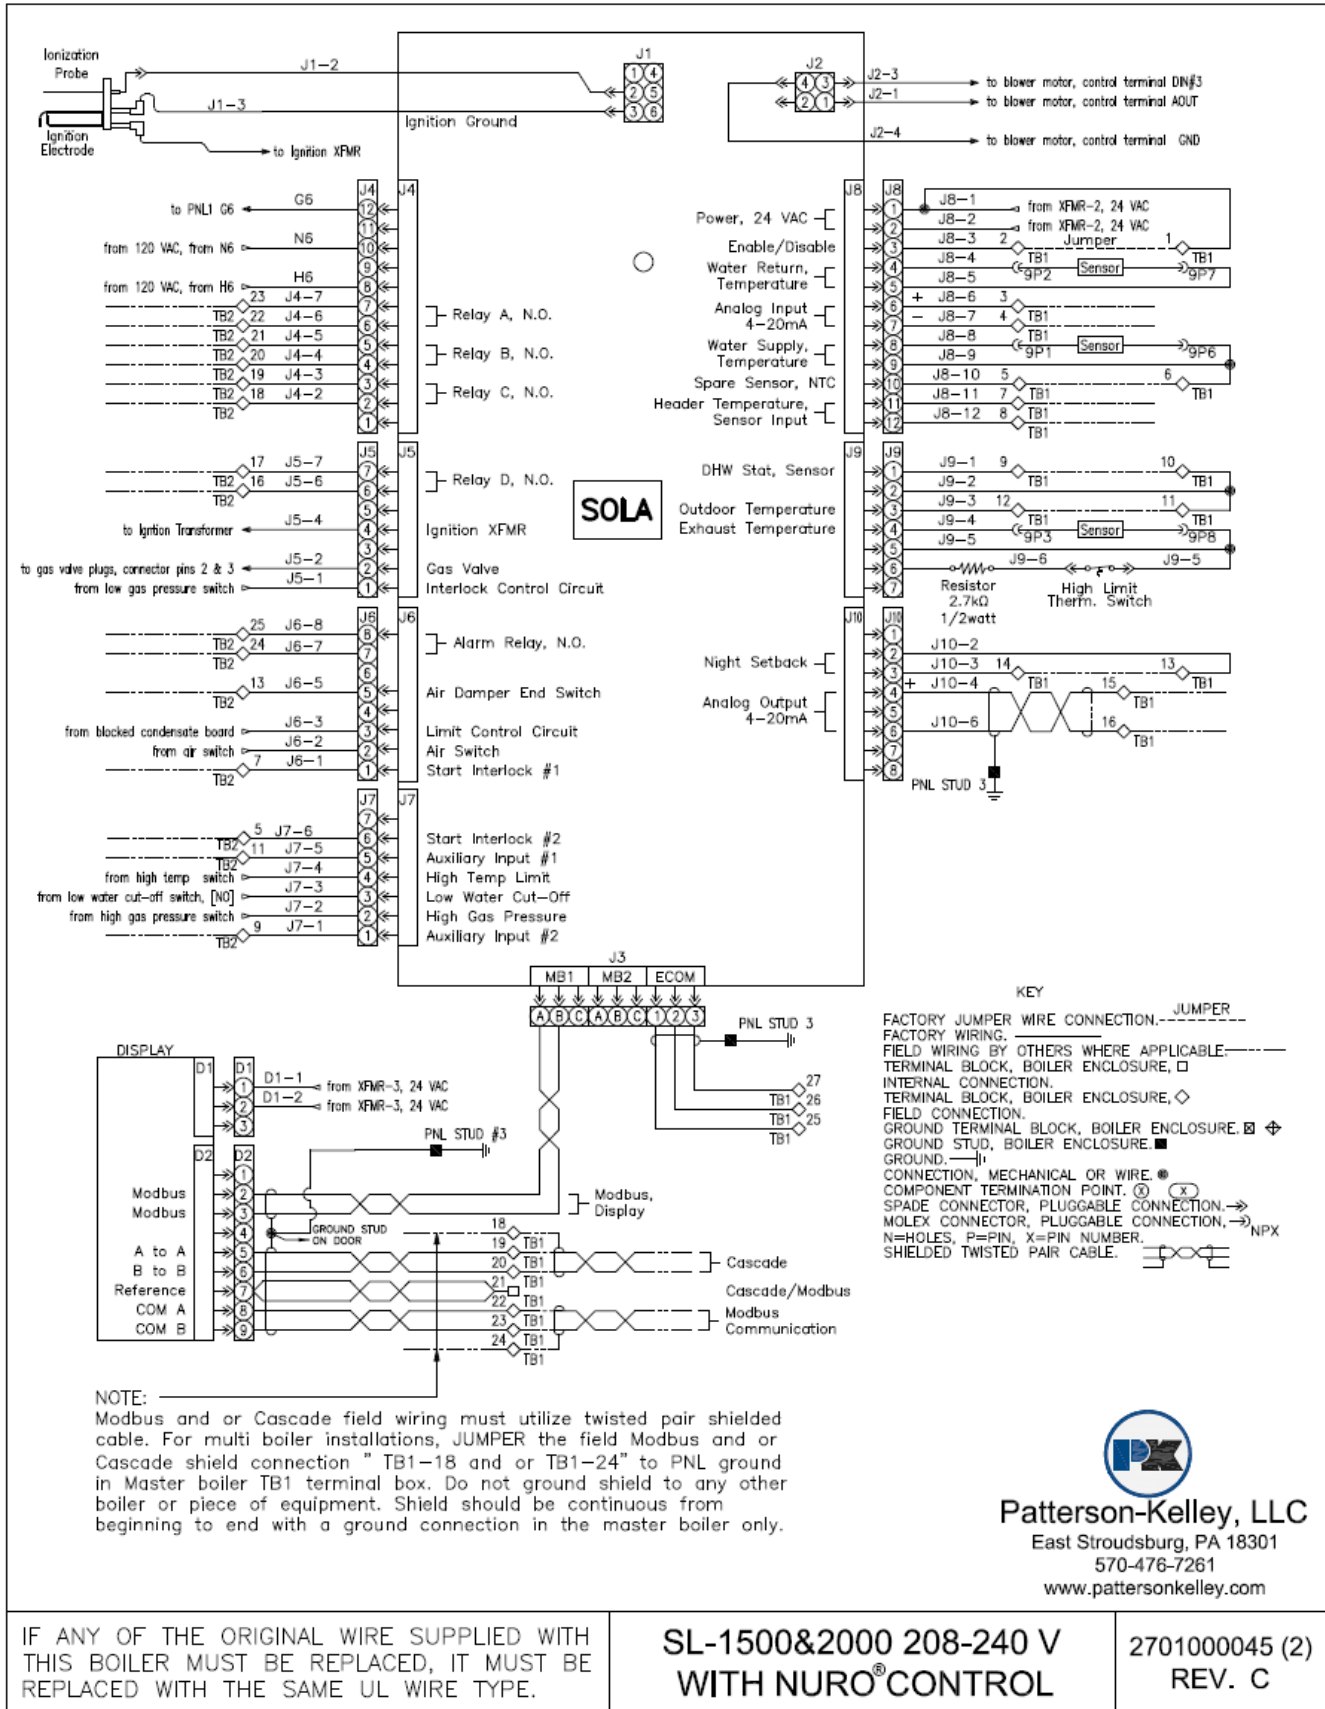

IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

SL-1500&2000 208-240 V
WITH NURO® CONTROL

270100045 (2)
 REV. C



Patterson-Kelley, LLC
 East Stroudsburg, PA 18301
 570-476-7261
 www.pattersonkelley.com