


IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

ST5000 240 V

WITH NURO® CONTROL

2691000319 (1)
REV. B

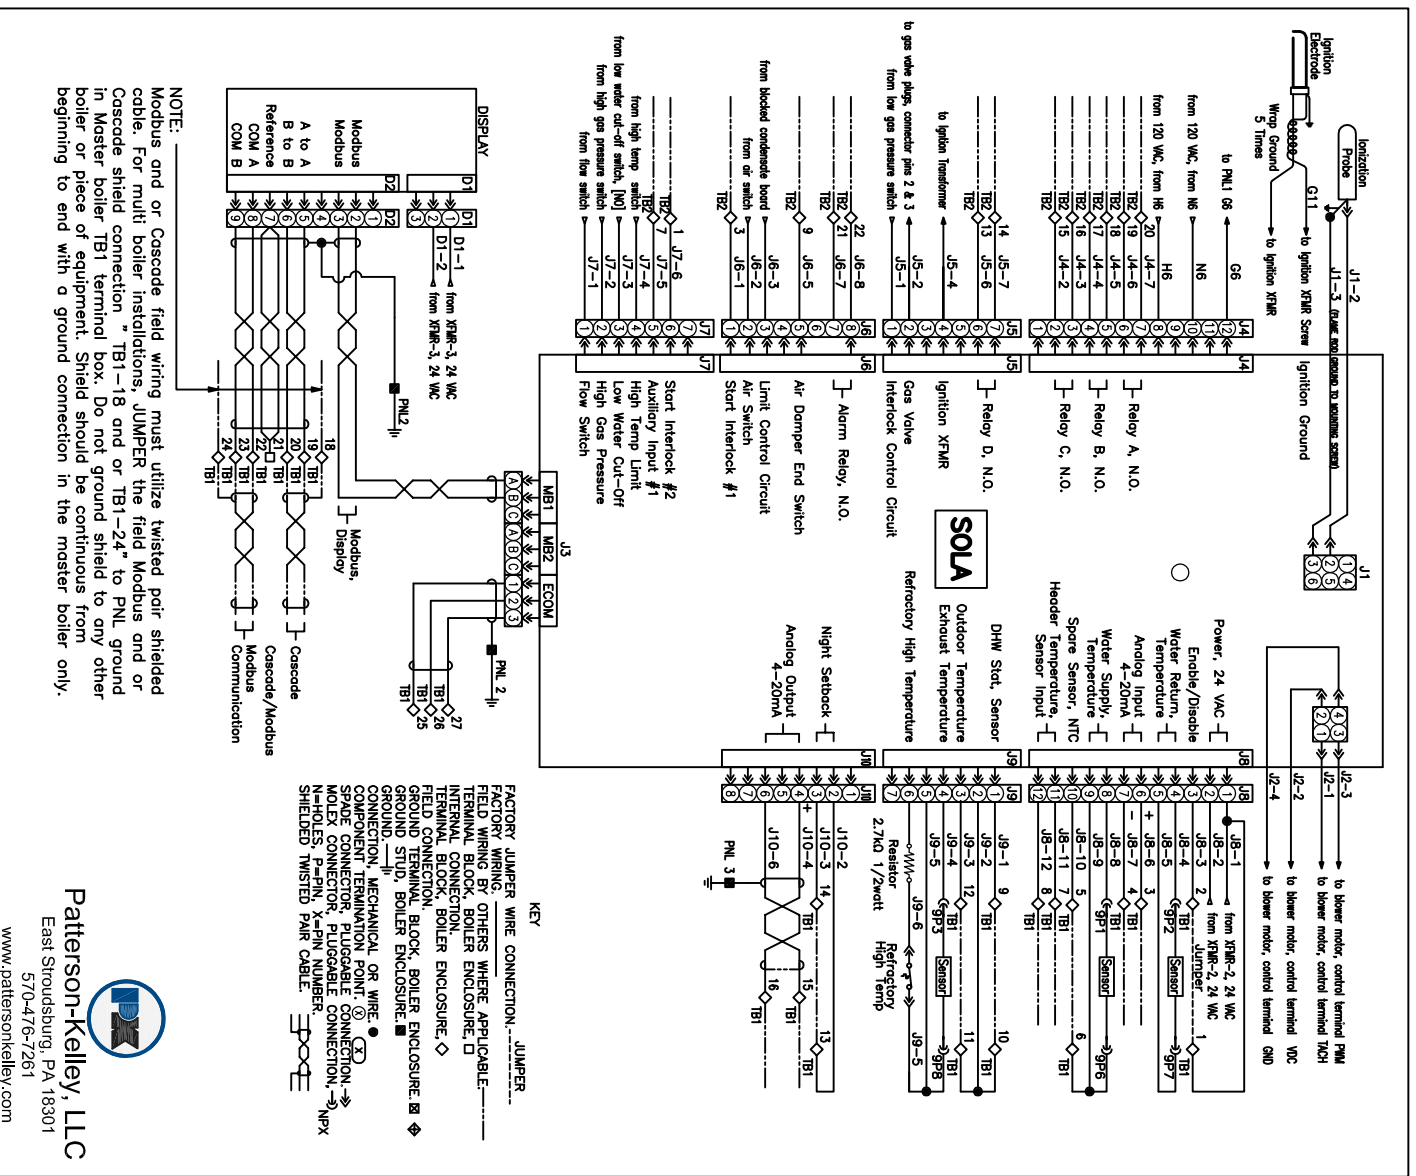

IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

ST5000 240 V

WITH NURO® CONTROL

2691000319 (1)
REV. B

www.pattersonkelley.com

Patterson-Kelley, LLC
East Stroudsburg, PA 18301
570-476-7261

www.pattersonkelley.com

Patterson-Kelley, LLC
East Stroudsburg, PA 18301
570-476-7261

REV	DESCRIPTION	BY	CHECK	DATE
A	REVISIONS	KWR	AJP	12/21/12
B	UPDATING WIRING DIAGS PER COMMENTS	TJS	AMS	10/21/12

REV	DESCRIPTION	BY	CHECK	DATE
D	DRAWING NUMBER	KWR	AJP	9/1/20
B	REFERENCE	KWR	AJP	9/1/20

WRG_DIAG,ST5000,240V,NURO

THIS DRAWING, INFORMATION, AND THE SUBJECT MATTER THEREOF, ARE THE SOLE AND EXCLUSIVE PROPERTY OF PATTERSON-KELLEY, LLC. NO PART OF THIS DRAWING OR INFORMATION IS TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT WRITTEN CONSENT FROM OUR COMPANY.