


IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

ST6000 240 V WITH NURO® CONTROL

2691000320 (1) REV. A

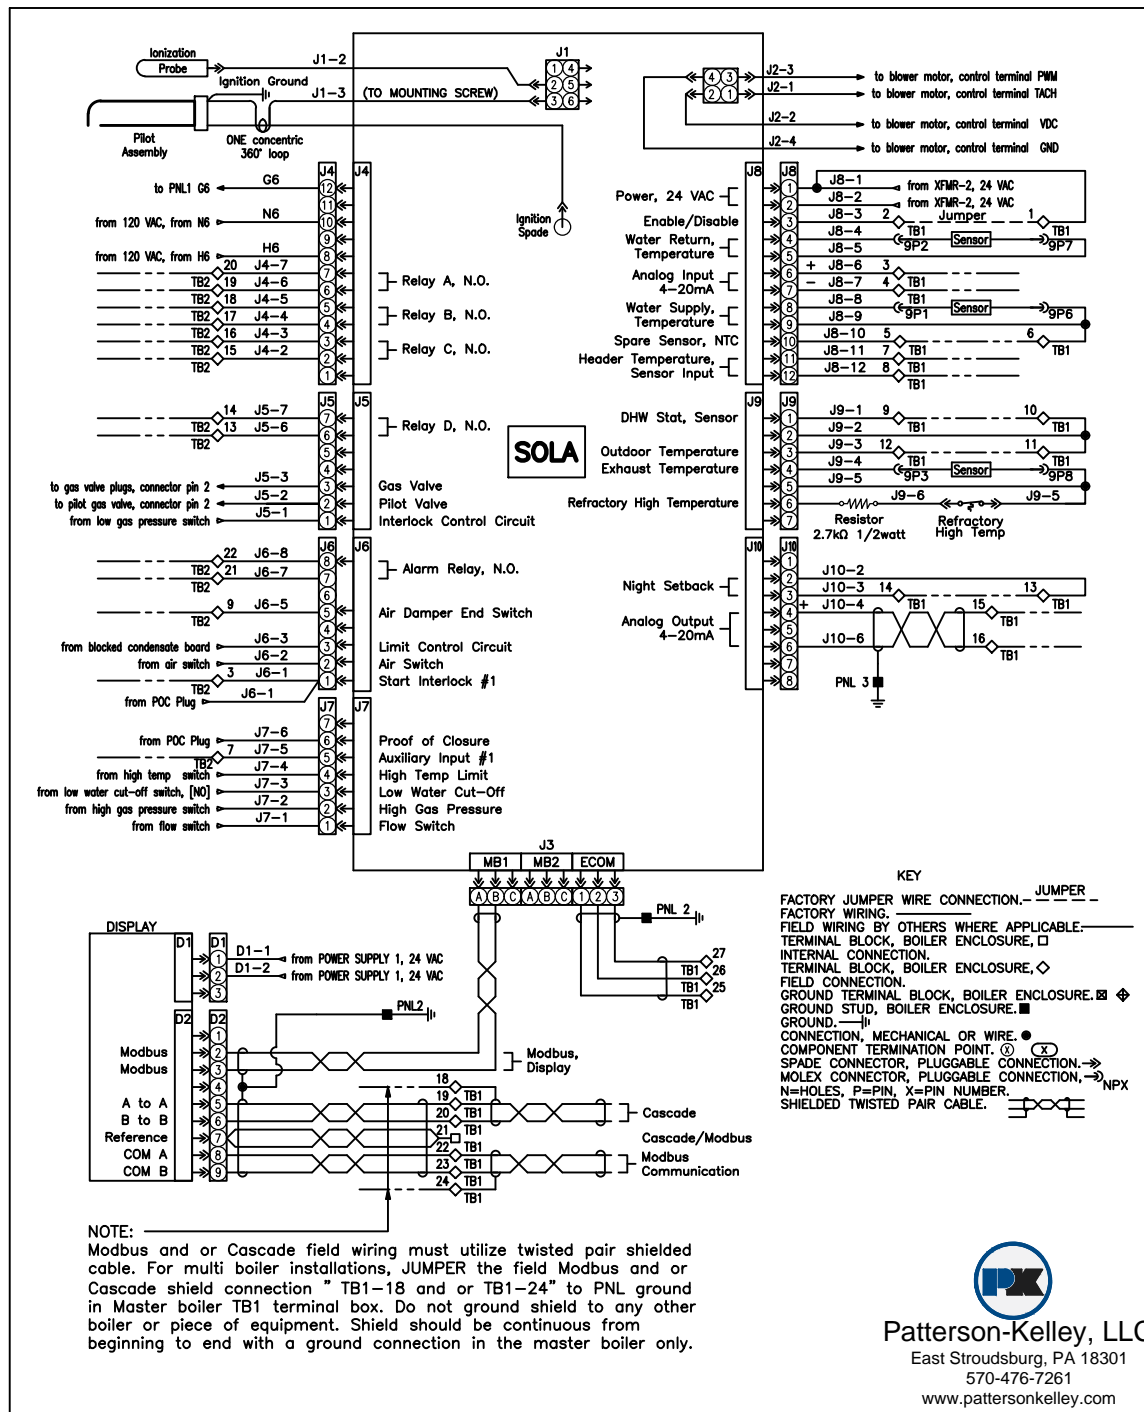

IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

ST6000 240 V WITH NURO® CONTROL

2691000320 (2) REV. A

TITLE		WRG_DIAG,ST6000,240V,NURO	
Patterson-Kelley, LLC East Stroudsburg, PA 18301 570-476-7261 www.pattersonkelley.com		THIS DRAWING, INFORMATION, AND THE SUBJECT MATTER THEREOF ARE THE SOLE AND EXCLUSIVE PROPERTY OF PATTERSON-KELLEY, LLC. EAST STROUDSBURG, PA 18301 USA IT MAY BE REPRODUCED BY THE PURCHASER OF THIS EQUIPMENT FOR THEIR INTERNAL USE ONLY. IT CANNOT BE DISTRIBUTED TO ANY OTHER FIRM OR PARTY WITHOUT WRITTEN CONSENT FROM OUR COMPANY.	
BY	DATE	FILE SIZE	REFERENCE NUMBER
KWR	10/27/20		
CHECKED	AJP	10/27/20	
APPROVED	CE	10/27/20	
DRAWING NUMBER	2691000320		REV
			A

REV	DESCRIPTION	BY	CHECK	DATE
A	RELEASED FOR PROTOTYPE	KWR	AJP	10/11/21